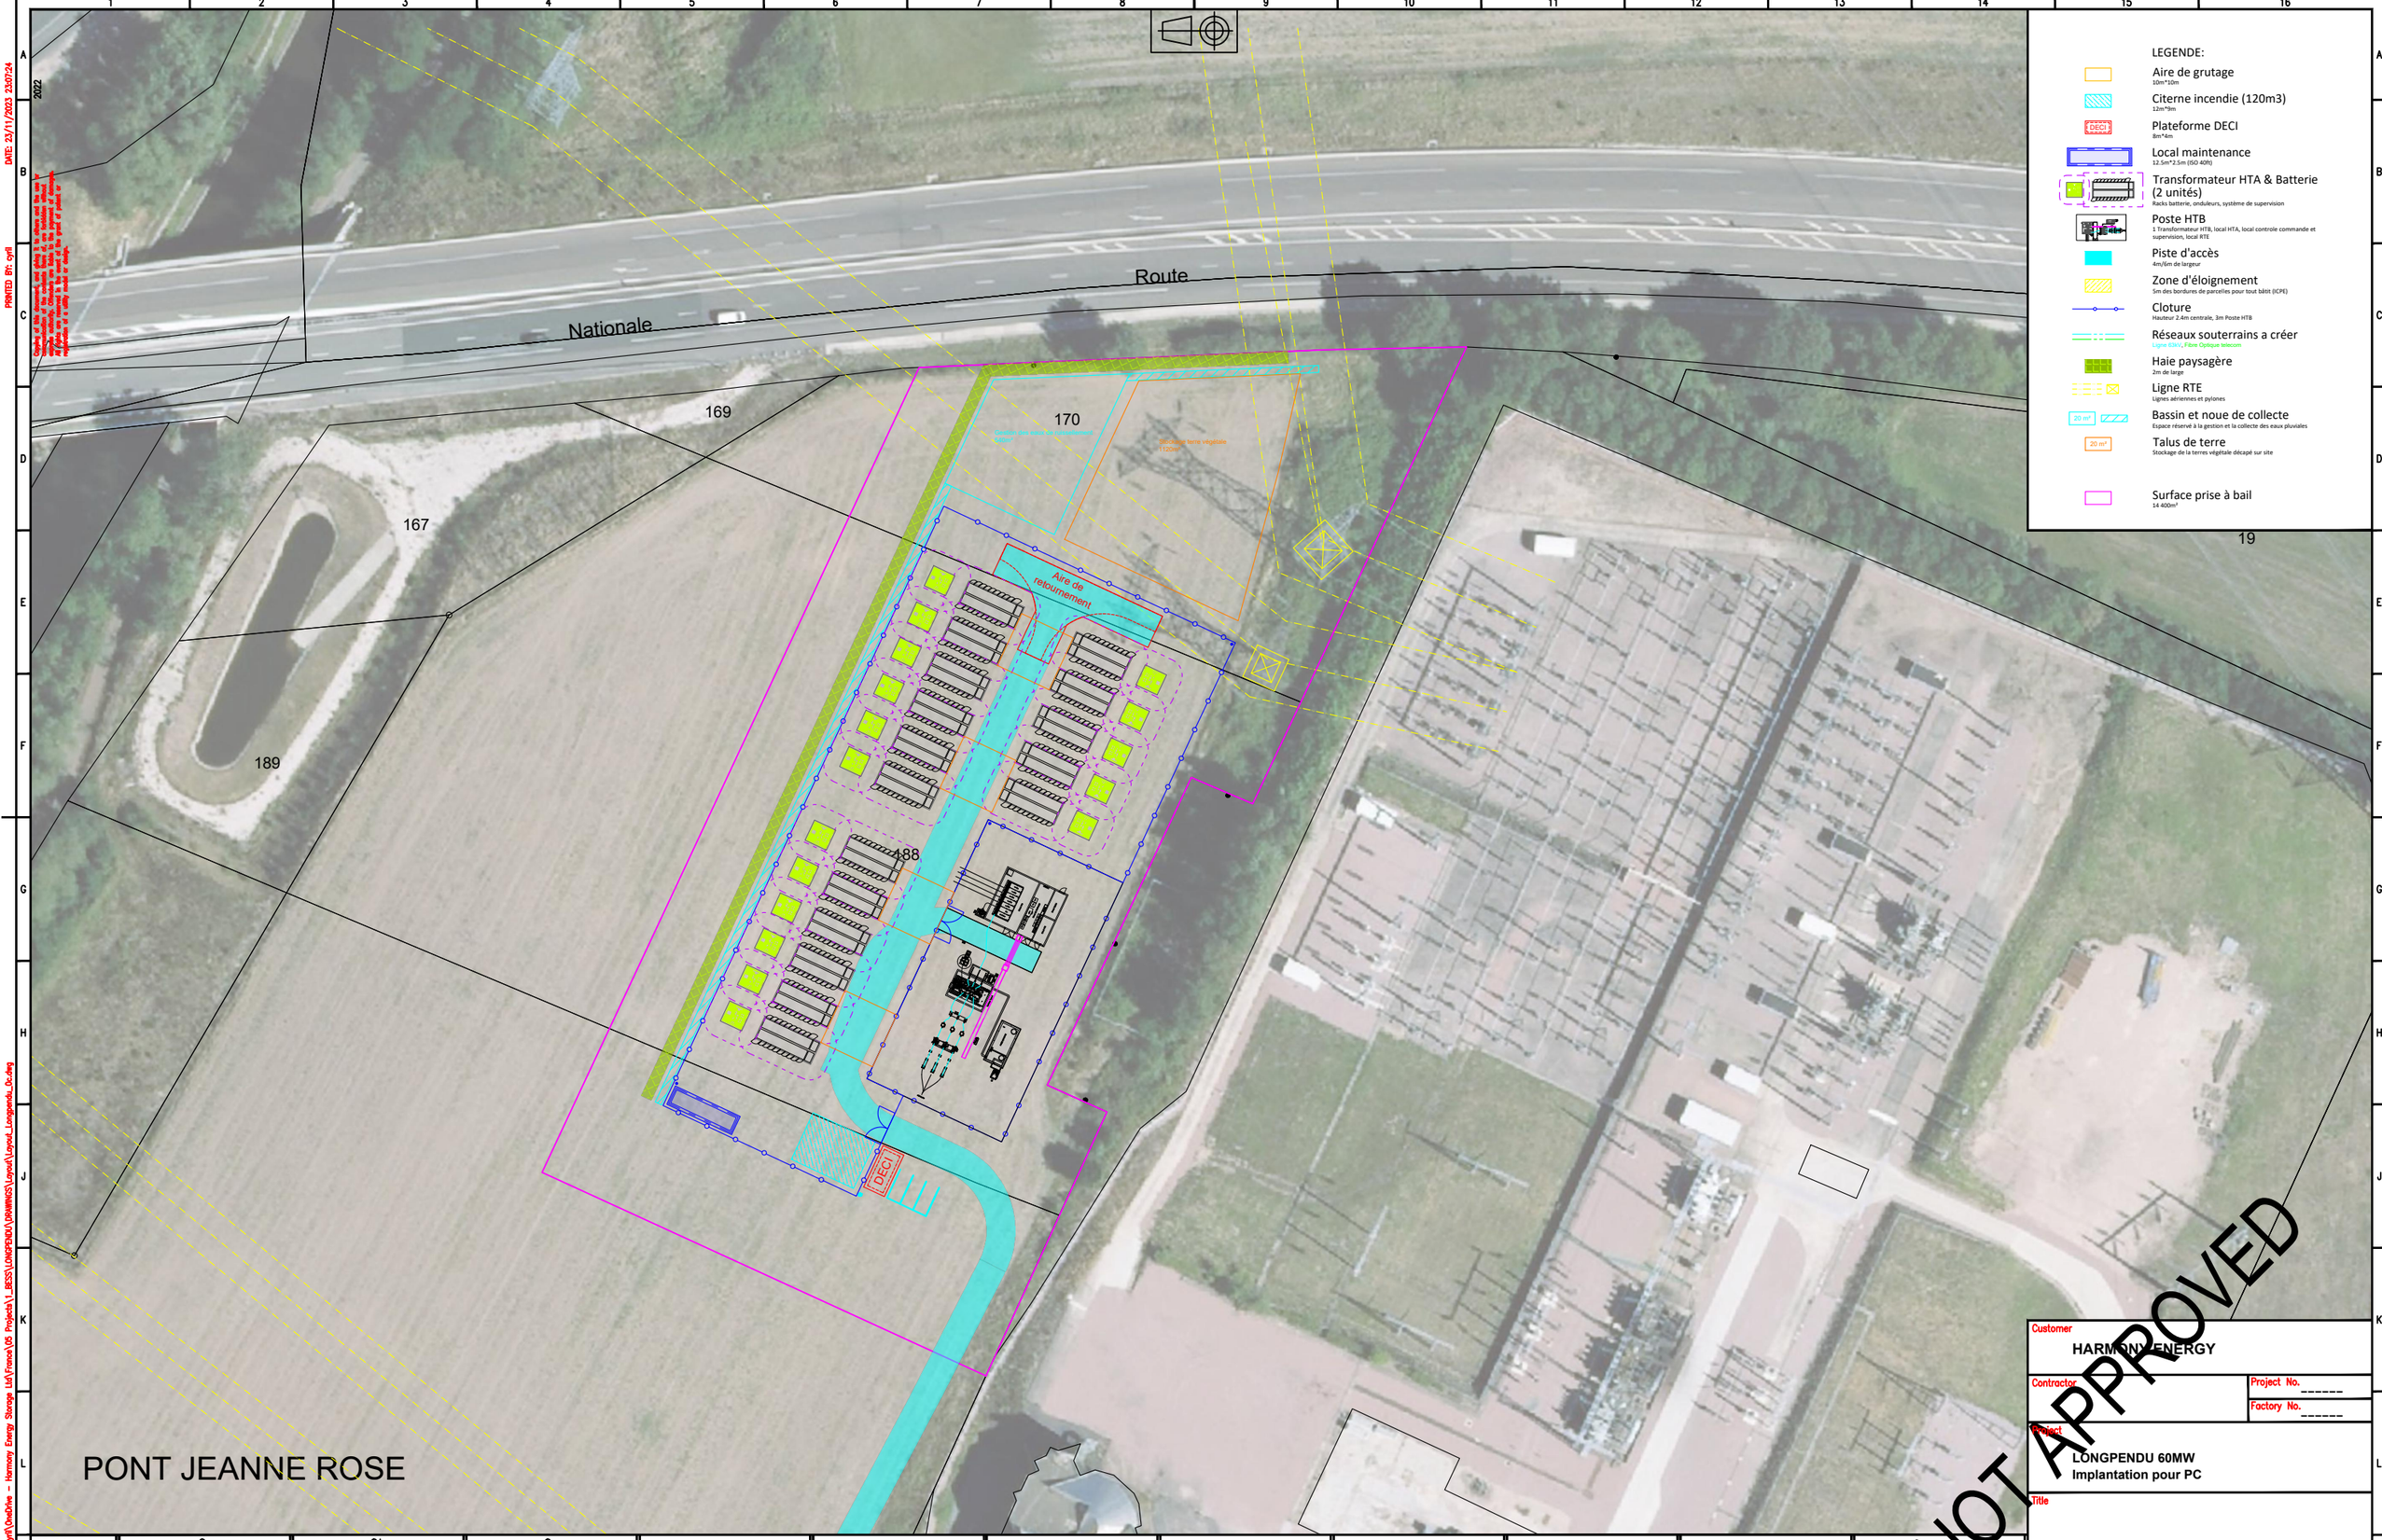

REVISION	0a		0b		0c
DRAWN BY:	CRO	FIRST ISSUE	CRO	Accès pylônes RTE	CRO
CHECKED BY:	.		.		
APPROVED BY:	.		.		
ISSUE DATE:	03/11/2023		13/11/2023		23/11/2023

Customer: HARMONY ENERGY

Contractor

Project No. ------

Factory No. ------

Project: LONGPENDU 60MW
Implantation pour PC

Title: .

Contractor Dwg.No.

Customer Dwg.No.

Approved	Checked	Designed	Drawn	Sheet 001
.	.	.	CRO	of 001
Date .	Scale 1/500	Drawing Size A3		Revision 0

PATH & FILENAME: C:\Users\Cyril\OneDrive - Harmony Energy Storage Ltd\France\05 Projects\1_BESS\LONGPENDU\DRAWINGS\Layout\Layout_Longpendu_0c.dwg

PRINTED: BY: cyril

DATE: 23/11/2023 23:07:24